



## Cast-In Device Tub Box


1

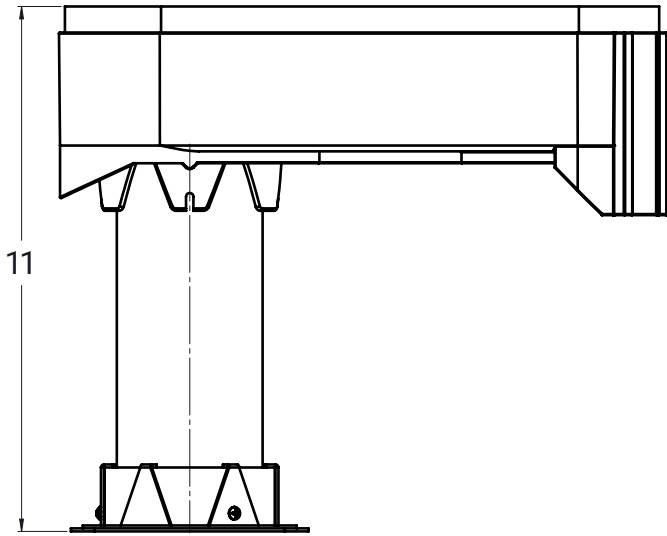


2

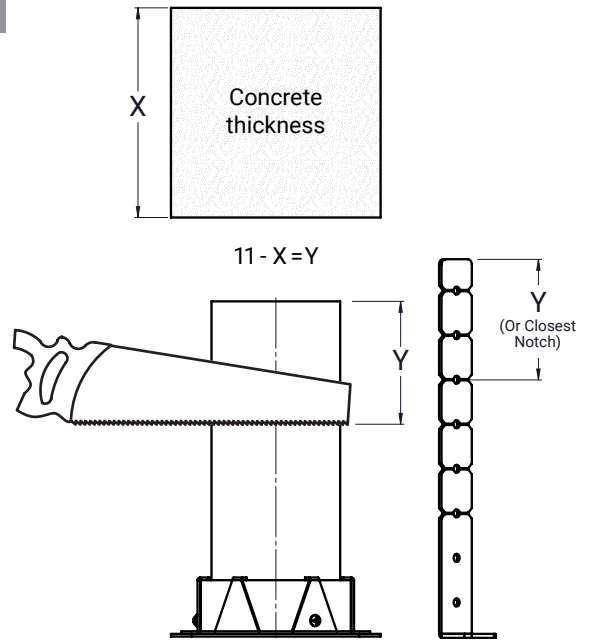

3

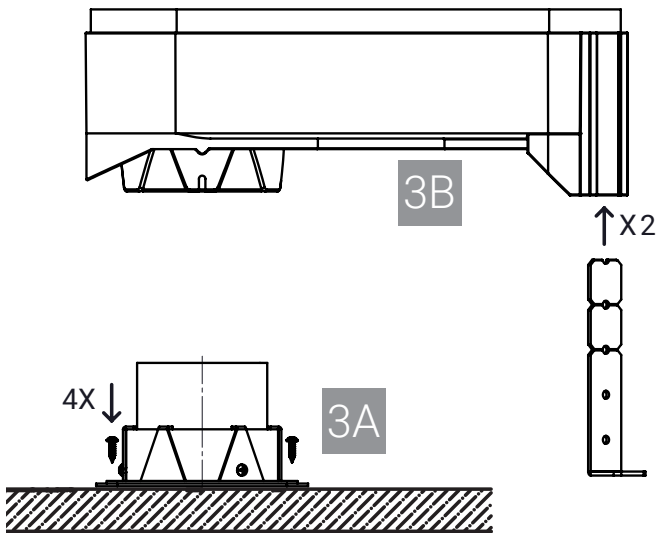


4

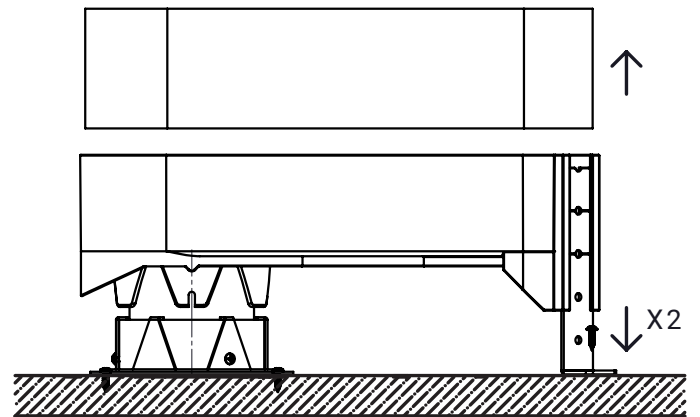


Note: For more information on firestop installation, refer to ASTM E3157.




5

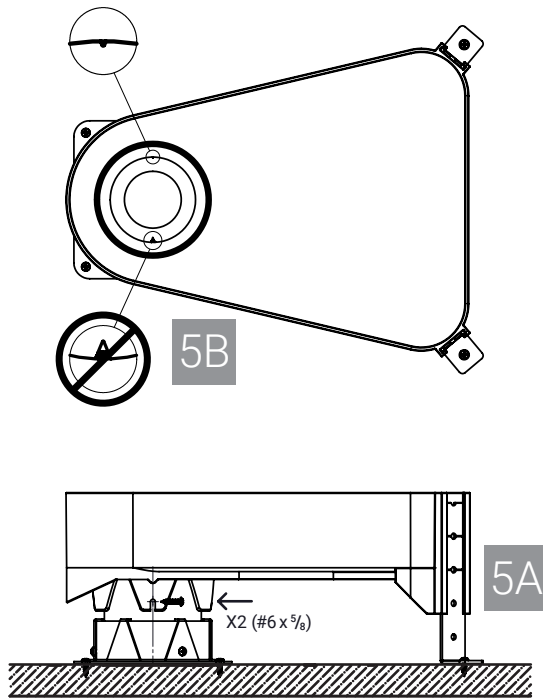


6

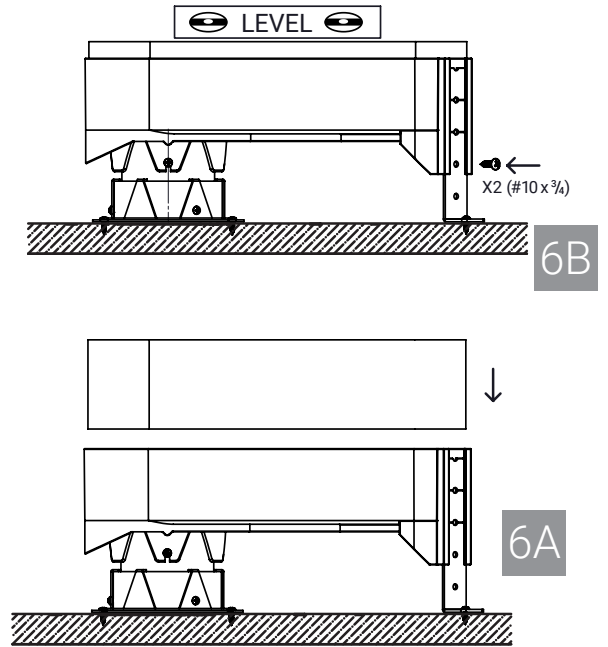

7

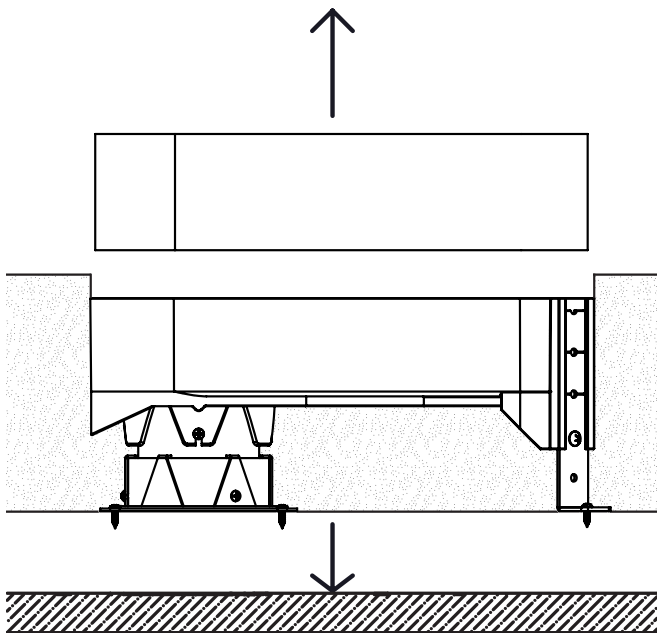

8

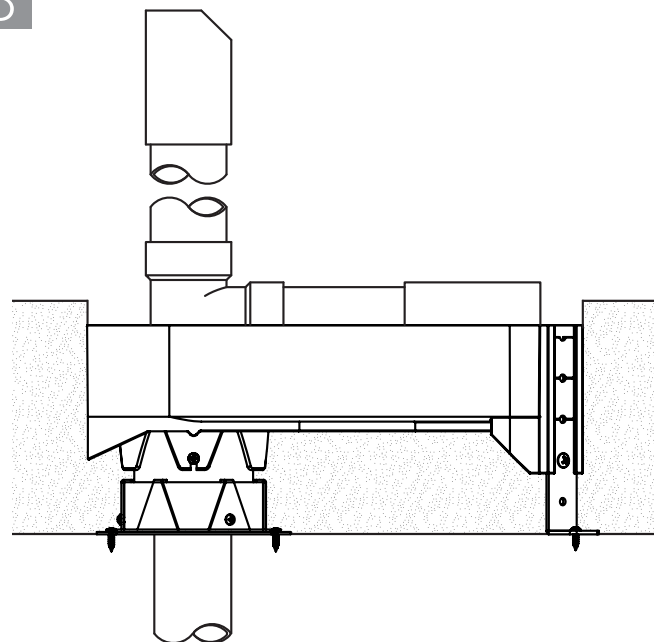

Note: For more information on firestop installation, refer to ASTM E3157.

