
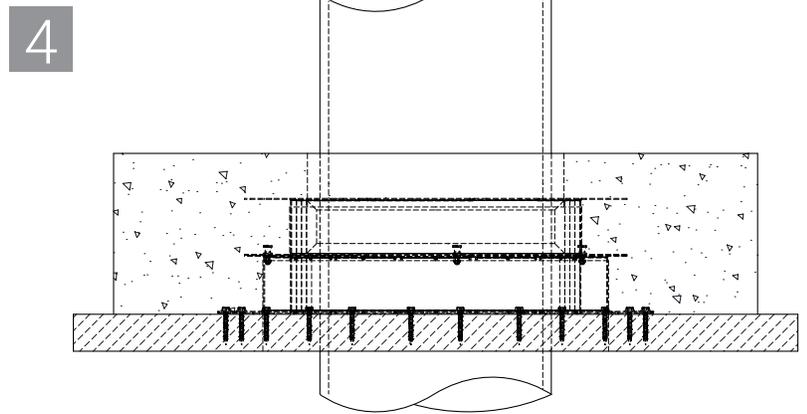
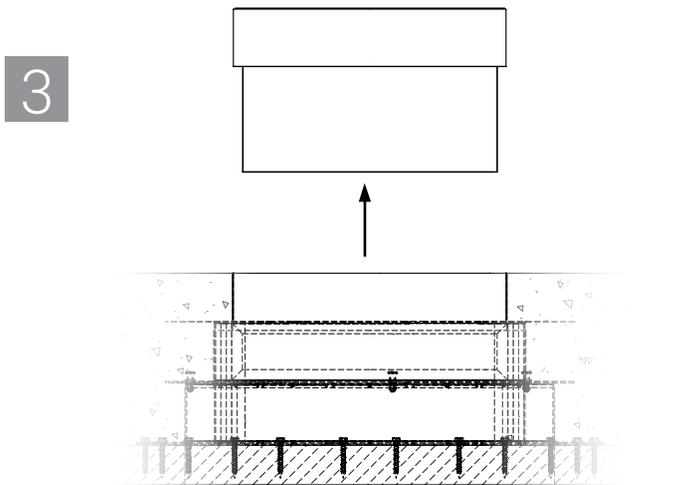
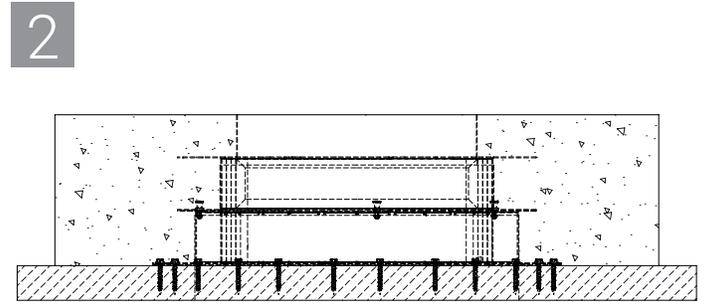
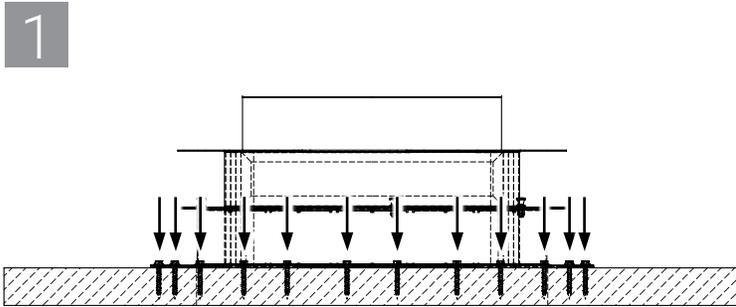


SpecSeal[®] 8 Inch Cast-In Firestop Device (CD801P/M - CD805P/M)

TABLE A: CONCRETE THICKNESS

Concrete Thickness	Device
6 in (152 mm)	CD801P/M
8 in (203 mm)	CD802P/M
10 in (254 mm)	CD803P/M
12 in (305 mm)	CD804P/M
14 in (356 mm)	CD805P/M

P/M = non-metallic/metallic pipe

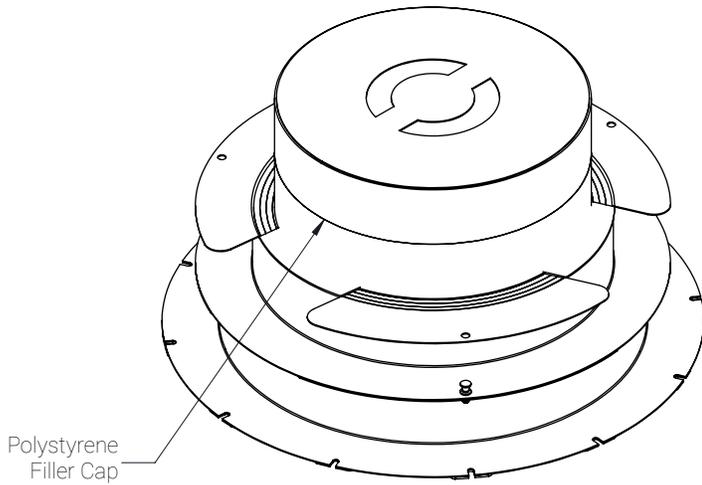

Note: For more information on firestop installation, refer to ASTM E3157.