



# NG-Test® CARBA 5




**5 simple steps!**

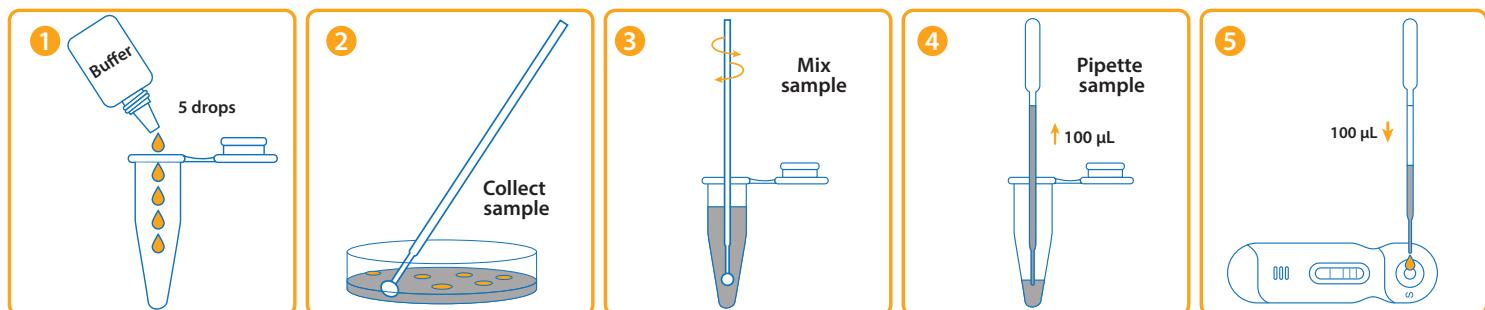


## Example of interpretation

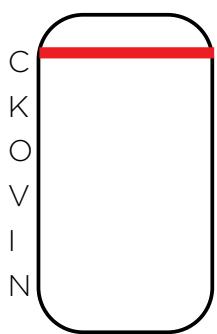


Negative

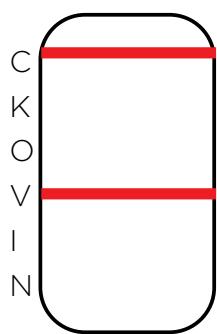

VIM Positive

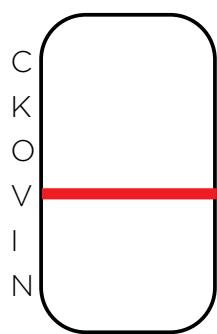

INVALID  
No control line

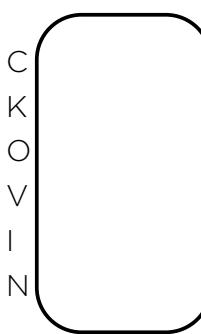

INVALID  
No control line

## Identification process from bacterial culture



The validated media is Blood, MacConkey, and/or HardyCHROM™ CRE Agar

| Description  | UOM               | Cat no. |
|--|-------------------|---------|
| <b>CARBA 5</b> , the only rapid, multiplex, phenotypic test capable of detecting KPC, OXA-48-like, VIM, IMP, and NDM carbapenemases produced by <i>Enterobacteriales</i> and <i>Pseudomonas aeruginosa</i> . | 20 tests per pack | CARBA5  |
| <b>HardyCHROM™ CRE Agar</b> , a chromogenic medium for detection of carbapenemase in <i>Enterobacteriaceae</i> . 15x100mm plate.   | 10 pack           | G323    |